



OPEN ACCESS

APPROVED BY
Frontiers Editorial Office,
Frontiers Media SA, Switzerland

*CORRESPONDENCE
Marco Vugman Wainstein
✉ mwainstein@hcupa.edu.br

RECEIVED 04 September 2025
ACCEPTED 08 September 2025
PUBLISHED 29 September 2025

CITATION

Wainstein MV, Machado GP, Telo GH,
Silveira ADd, Nasi LA and Araujo GNd (2025)
Correction: Point-of-care ultrasound in the
evaluation of STEMI patients.
Front. Cardiovasc. Med. 12:1698664.
doi: 10.3389/fcvm.2025.1698664

COPYRIGHT

© 2025 Wainstein, Machado, Telo, Silveira,
Nasi and Araujo. This is an open-access article
distributed under the terms of the [Creative
Commons Attribution License \(CC BY\)](#). The
use, distribution or reproduction in other
forums is permitted, provided the original
author(s) and the copyright owner(s) are
credited and that the original publication in
this journal is cited, in accordance with
accepted academic practice. No use,
distribution or reproduction is permitted
which does not comply with these terms.

Correction: Point-of-care ultrasound in the evaluation of STEMI patients

Marco Vugman Wainstein^{1*} , Guilherme Pinheiro Machado¹ ,
Guilherme Heiden Telo¹ , Anderson Donelli da Silveira¹ ,
Luiz Antônio Nasi¹ and Gustavo Neves de Araujo²

¹Cardiology Department, Hospital de Clínicas de Porto Alegre, Porto Alegre, Brazil, ²Cardiology Department, Hospital Unimed Grande Florianópolis, Florianópolis, Brazil

KEYWORDS

STEMI, point-of-care ultrasound, lung ultrasound, LVOT-VTI, acute heart failure, cardiogenic shock

A Correction on

Point-of-care ultrasound in the evaluation of STEMI patients

By Wainstein MV, Machado GP, Telo GH, Silveira ADd, Nasi LA and Araujo GNd (2025). Front. Cardiovasc. Med. 12:1627396. doi: 10.3389/fcvm.2025.1627396

There was a mistake in Figure 1 as published. Figure 1 currently contain the FASTEMI logo, that overlap with material included in another manuscript from our group that is still under submission elsewhere. Our team is concerned that this overlap could potentially affect copyright considerations if that manuscript is accepted. The corrected [Figure 1](#) appears below.

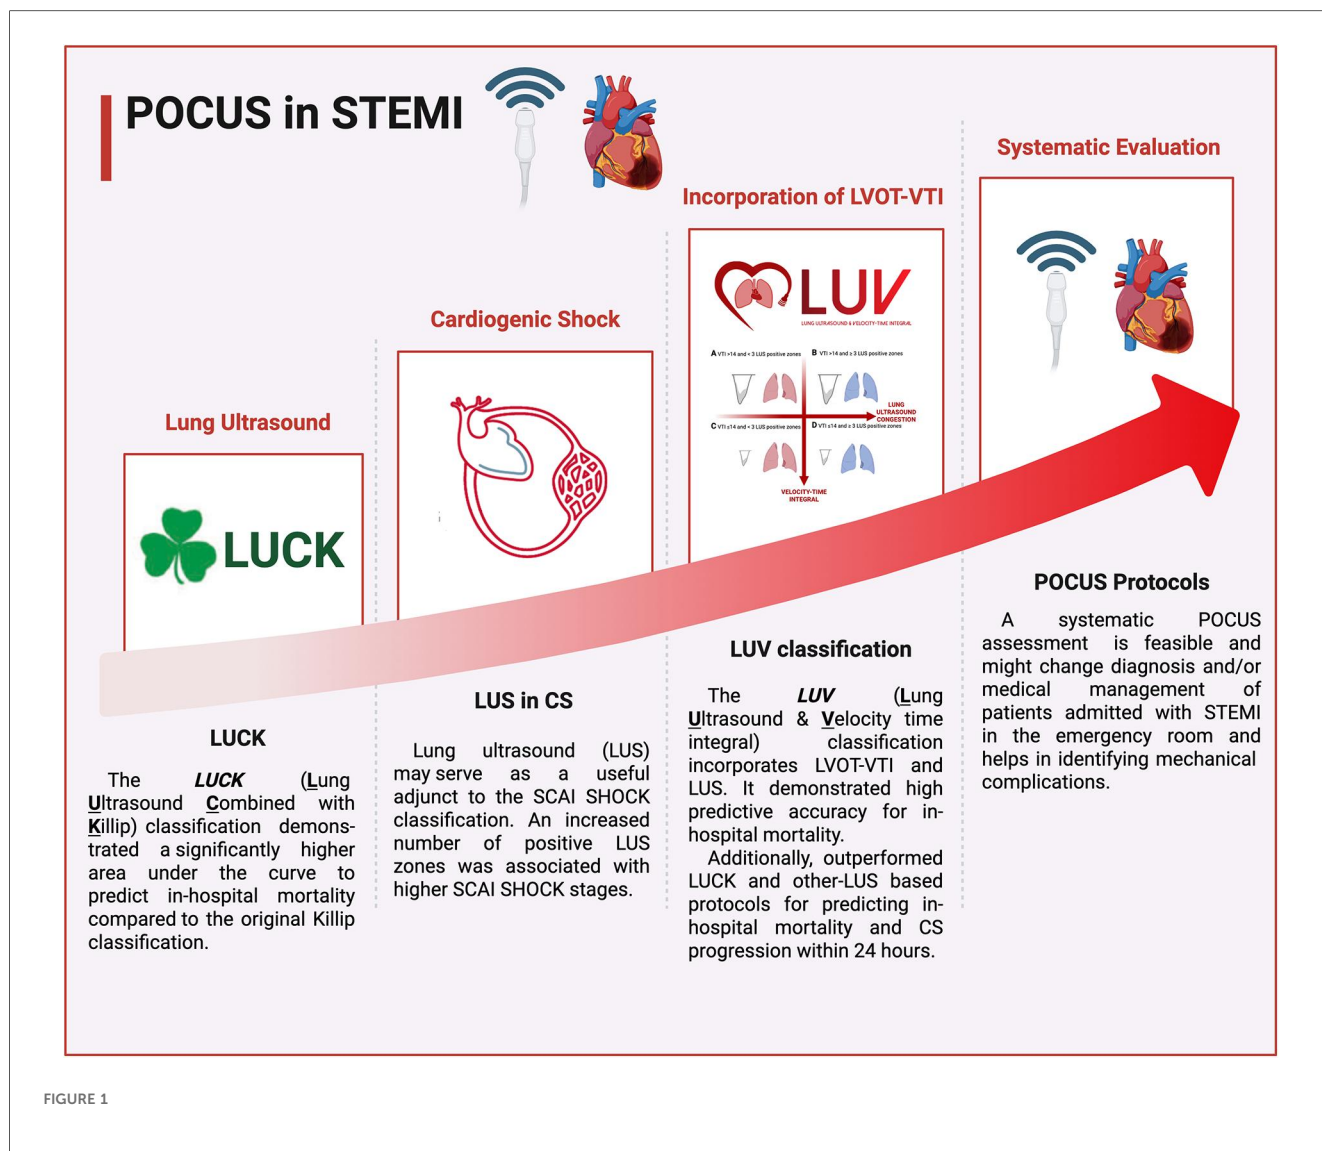


FIGURE 1

There was a mistake in Figure 4 as published. Figure 4 currently contain elements that overlap with material included in another manuscript from our group that is still under submission elsewhere. Our team is concerned that this overlap could potentially affect copyright considerations if that manuscript is accepted. The corrected Figure 4 appears below.

There was a mistake in the caption of Figure 4 as published. The corrected caption of Figure 4 appears below.

“Checklist of parameters suggested in a systemic evaluation protocol. Figure created in Biorender.com.”

The acknowledgements was omitted. The acknowledgements appears below.

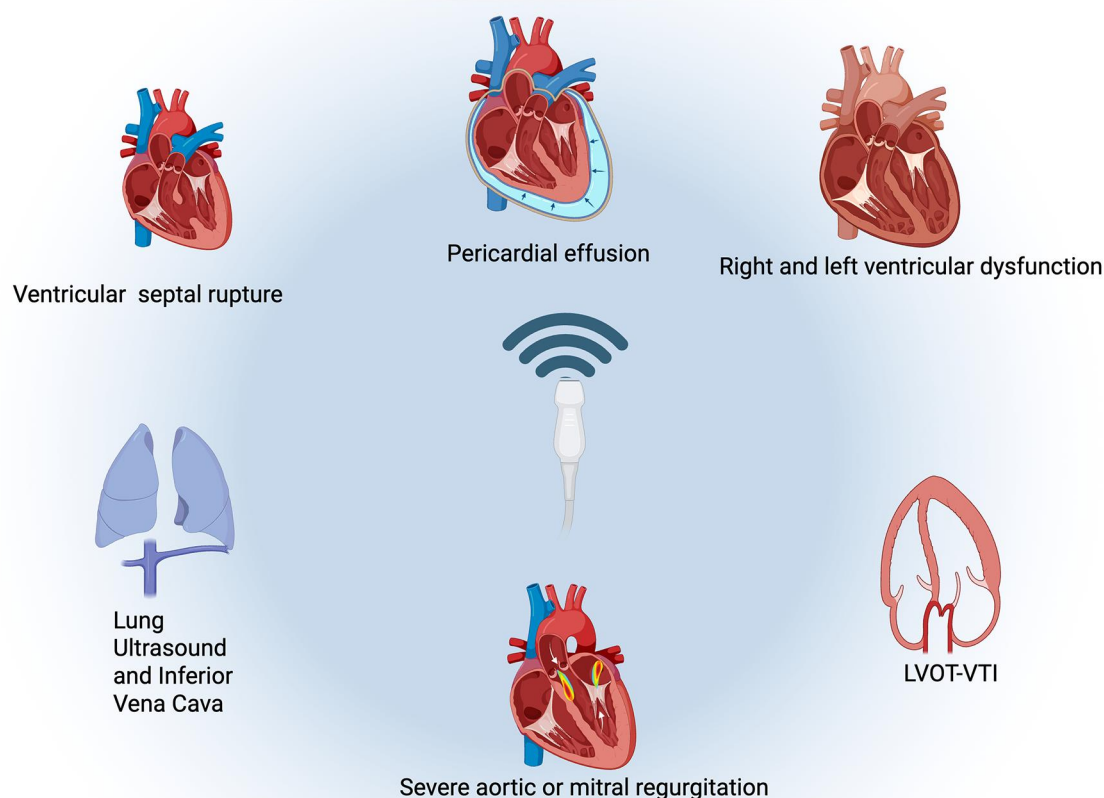


FIGURE 4

Acknowledgments

The authors gratefully acknowledge the members of the research group for their essential contributions to this study. We would like to recognize, in alphabetical order: Andre Amon, Alan Pagnoncelli, Alexander G. Truesdell, Felipe C. Fuchs, Felipe P. Marques, Fernando Luis Scolari, Joao Pedro da Rosa Barbato, Luiz Carlos Corsetti Bergoli, Rafael Beltrame, Rodrigo Wainstein, Sandro Cadaval Goncalves, Tiago L. Leiria, and Wiliam Menegazzo.

The original version of this article has been updated.

Generative AI statement

Any alternative text (alt text) provided alongside figures in this article has been generated by Frontiers with the

support of artificial intelligence and reasonable efforts have been made to ensure accuracy, including review by the authors wherever possible. If you identify any issues, please contact us.

Publisher's note

All claims expressed in this article are solely those of the authors and do not necessarily represent those of their affiliated organizations, or those of the publisher, the editors and the reviewers. Any product that may be evaluated in this article, or claim that may be made by its manufacturer, is not guaranteed or endorsed by the publisher.